

READ AND UNDERSTAND THESE INSTRUCTIONS BEFORE INSTALLING FIXTURE

This fixture is intended for installation in accordance with the National Electrical Code and local regulations. To assure full compliance with local codes and regulations, check with your local electrical inspector before installation. To prevent electric shock, turn off electricity at fuse box before proceeding.

Retain these instructions for maintenance reference.

INSTRUCTION SHEET NO.


IS: AUX-E

A0504

Page 1 of 2

INSTRUCTIONS FOR H.I.D. FRAME-IN KITS AND FINISHING SECTIONS WITH OPTIONAL AUXILIARY AND EMERGENCY LIGHTING

CAUTION: (RISK OF FIRE) DO NOT INSTALL INSULATION ABOVE NOR WITHIN 3 INCHES (76mm) OF ANY PART OF THE LUMINAIRE (LIGHTING FIXTURE)

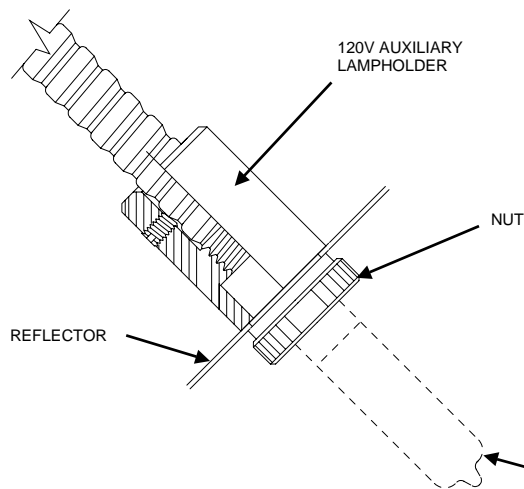


Installing 120V Auxiliary Lampholder onto Reflector

(NOTE: For Emergency Lighting applications, use same Auxiliary Lampholder Accessory without Auxiliary Lighting Control.)

1. Remove NUT from end of AUXILIARY LAMPHOLDER ASSEMBLY.
2. Insert threaded end of of AUXILIARY LAMPHOLDER ASSEMBLY into hole in REFLECTOR.
3. Secure AUXILIARY LAMPHOLDER ASSEMBLY on inside of REFLECTOR with NUT.
4. Some REFLECTORS are provided with a threaded insert. In these cases, simply screw end of AUXILIARY LAMPHOLDER ASSEMBLY directly into threaded insert, and discard NUT.
5. Follow directions included with Frame-in Kit and Trim to complete installation.
6. Refer to REFLECTOR labeling for correct wattage information installing auxiliary lamp.

120V Tungsten Halogen Lamp, D.C. Bayonet Base (not provided).
Refer to labeling on Frame and Trim for correct lamp and wattage

AUXILIARY LIGHTING WIRING DIAGRAM FOR METAL HALIDE MAGNETIC BALLASTS (120V/277V DUAL TAP)

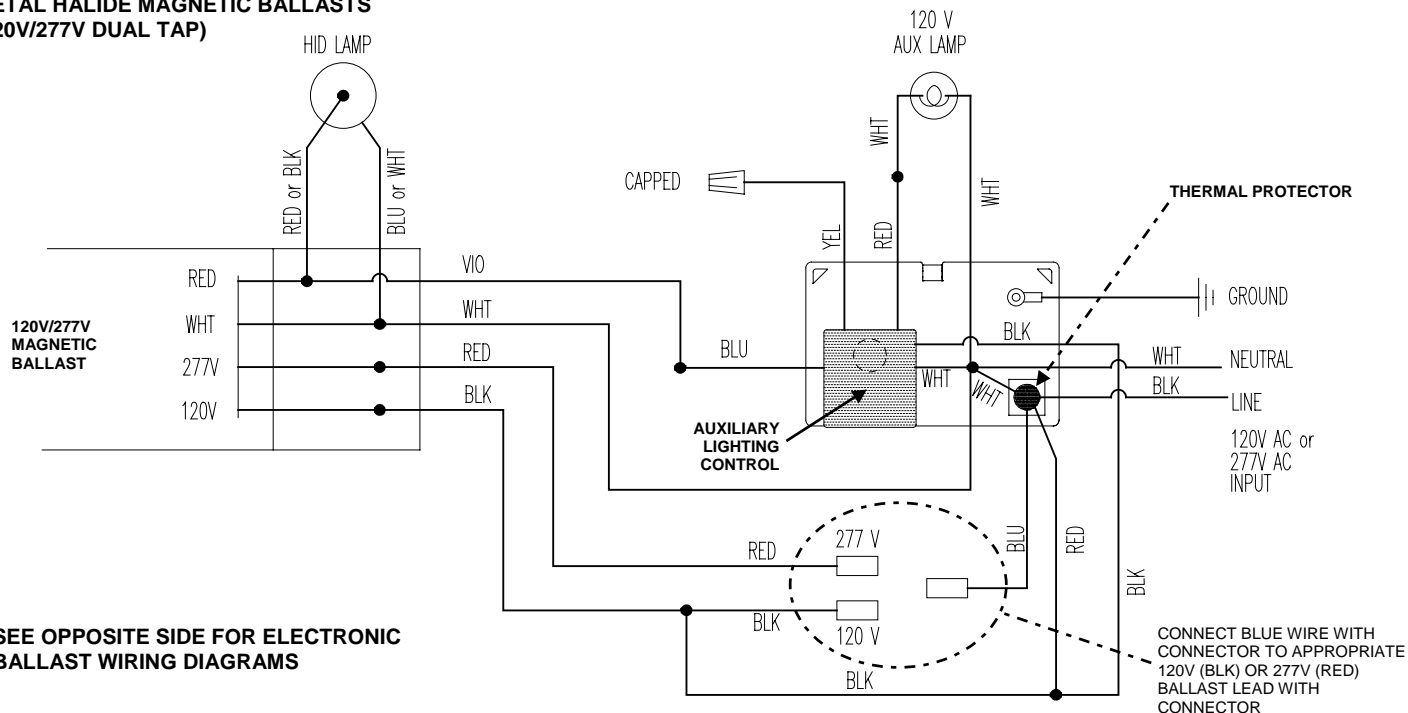

LIGHTOLIER®

LIGHTOLIER A GENLYTE THOMAS COMPANY
631 Airport Road, Fall River, MA 02720

READ AND UNDERSTAND THESE INSTRUCTIONS BEFORE INSTALLING FIXTURE

This fixture is intended for installation in accordance with the National Electrical Code and local regulations. To assure full compliance with local codes and regulations, check with your local electrical inspector before installation. To prevent electric shock, turn off electricity at fuse box before proceeding.

Retain these instructions for maintenance reference.

INSTRUCTION SHEET NO.

IS: AUX-E


A0504

Page 2 of 2


INSTRUCTIONS FOR H.I.D. FRAME-IN KITS AND FINISHING SECTIONS WITH OPTIONAL AUXILIARY AND EMERGENCY LIGHTING

CAUTION: (RISK OF FIRE) DO NOT INSTALL INSULATION ABOVE NOR WITHIN 3 INCHES (76mm) OF ANY PART OF THE LUMINAIRE (LIGHTING FIXTURE)

AUXILIARY LIGHTING WIRING DIAGRAM FOR 120V METAL HALIDE ELECTRONIC BALLAST

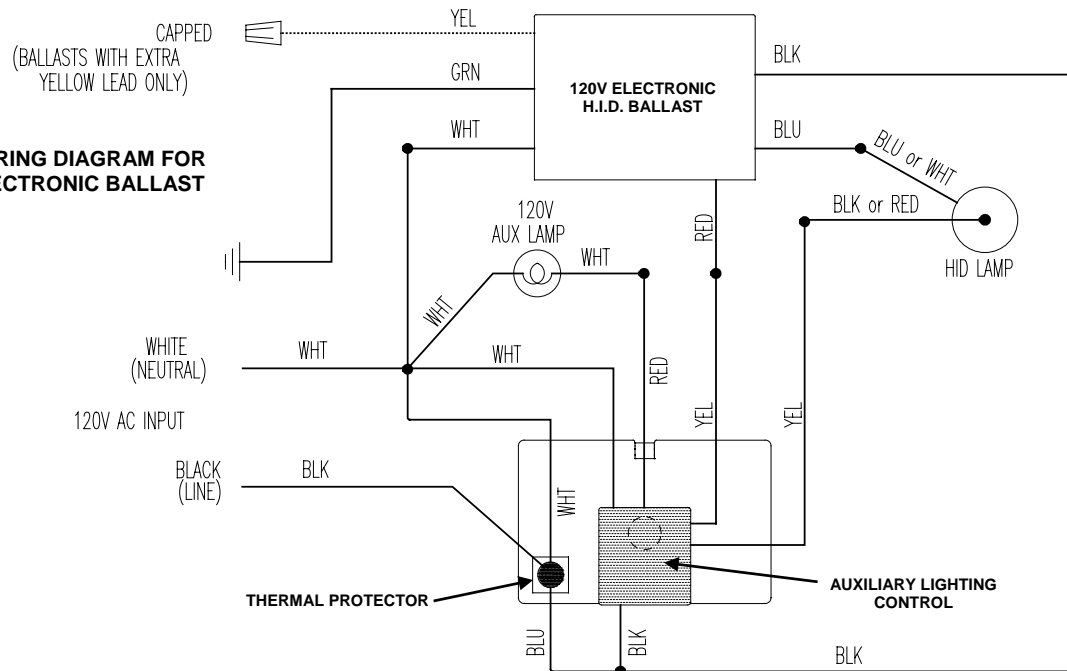

AUXILIARY LIGHTING WIRING DIAGRAM FOR 277V METAL HALIDE ELECTRONIC BALLAST

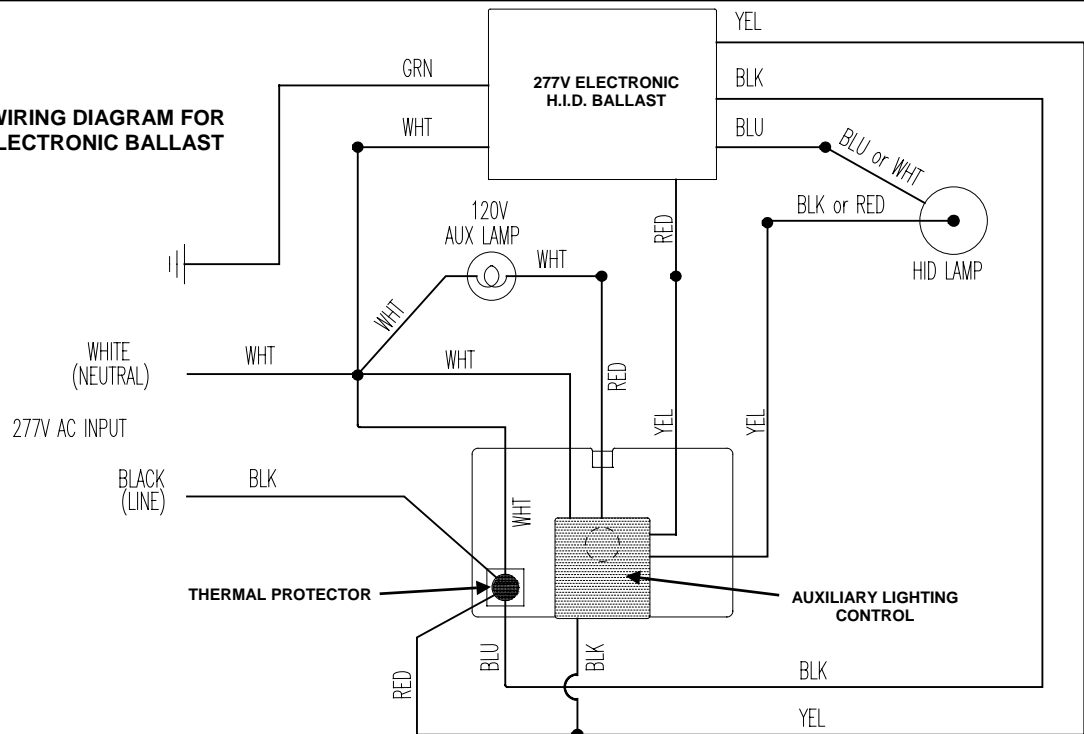

LIGHTOLIER®

LIGHTOLIER A GENLYTE THOMAS COMPANY
631 Airport Road, Fall River, MA 02720